

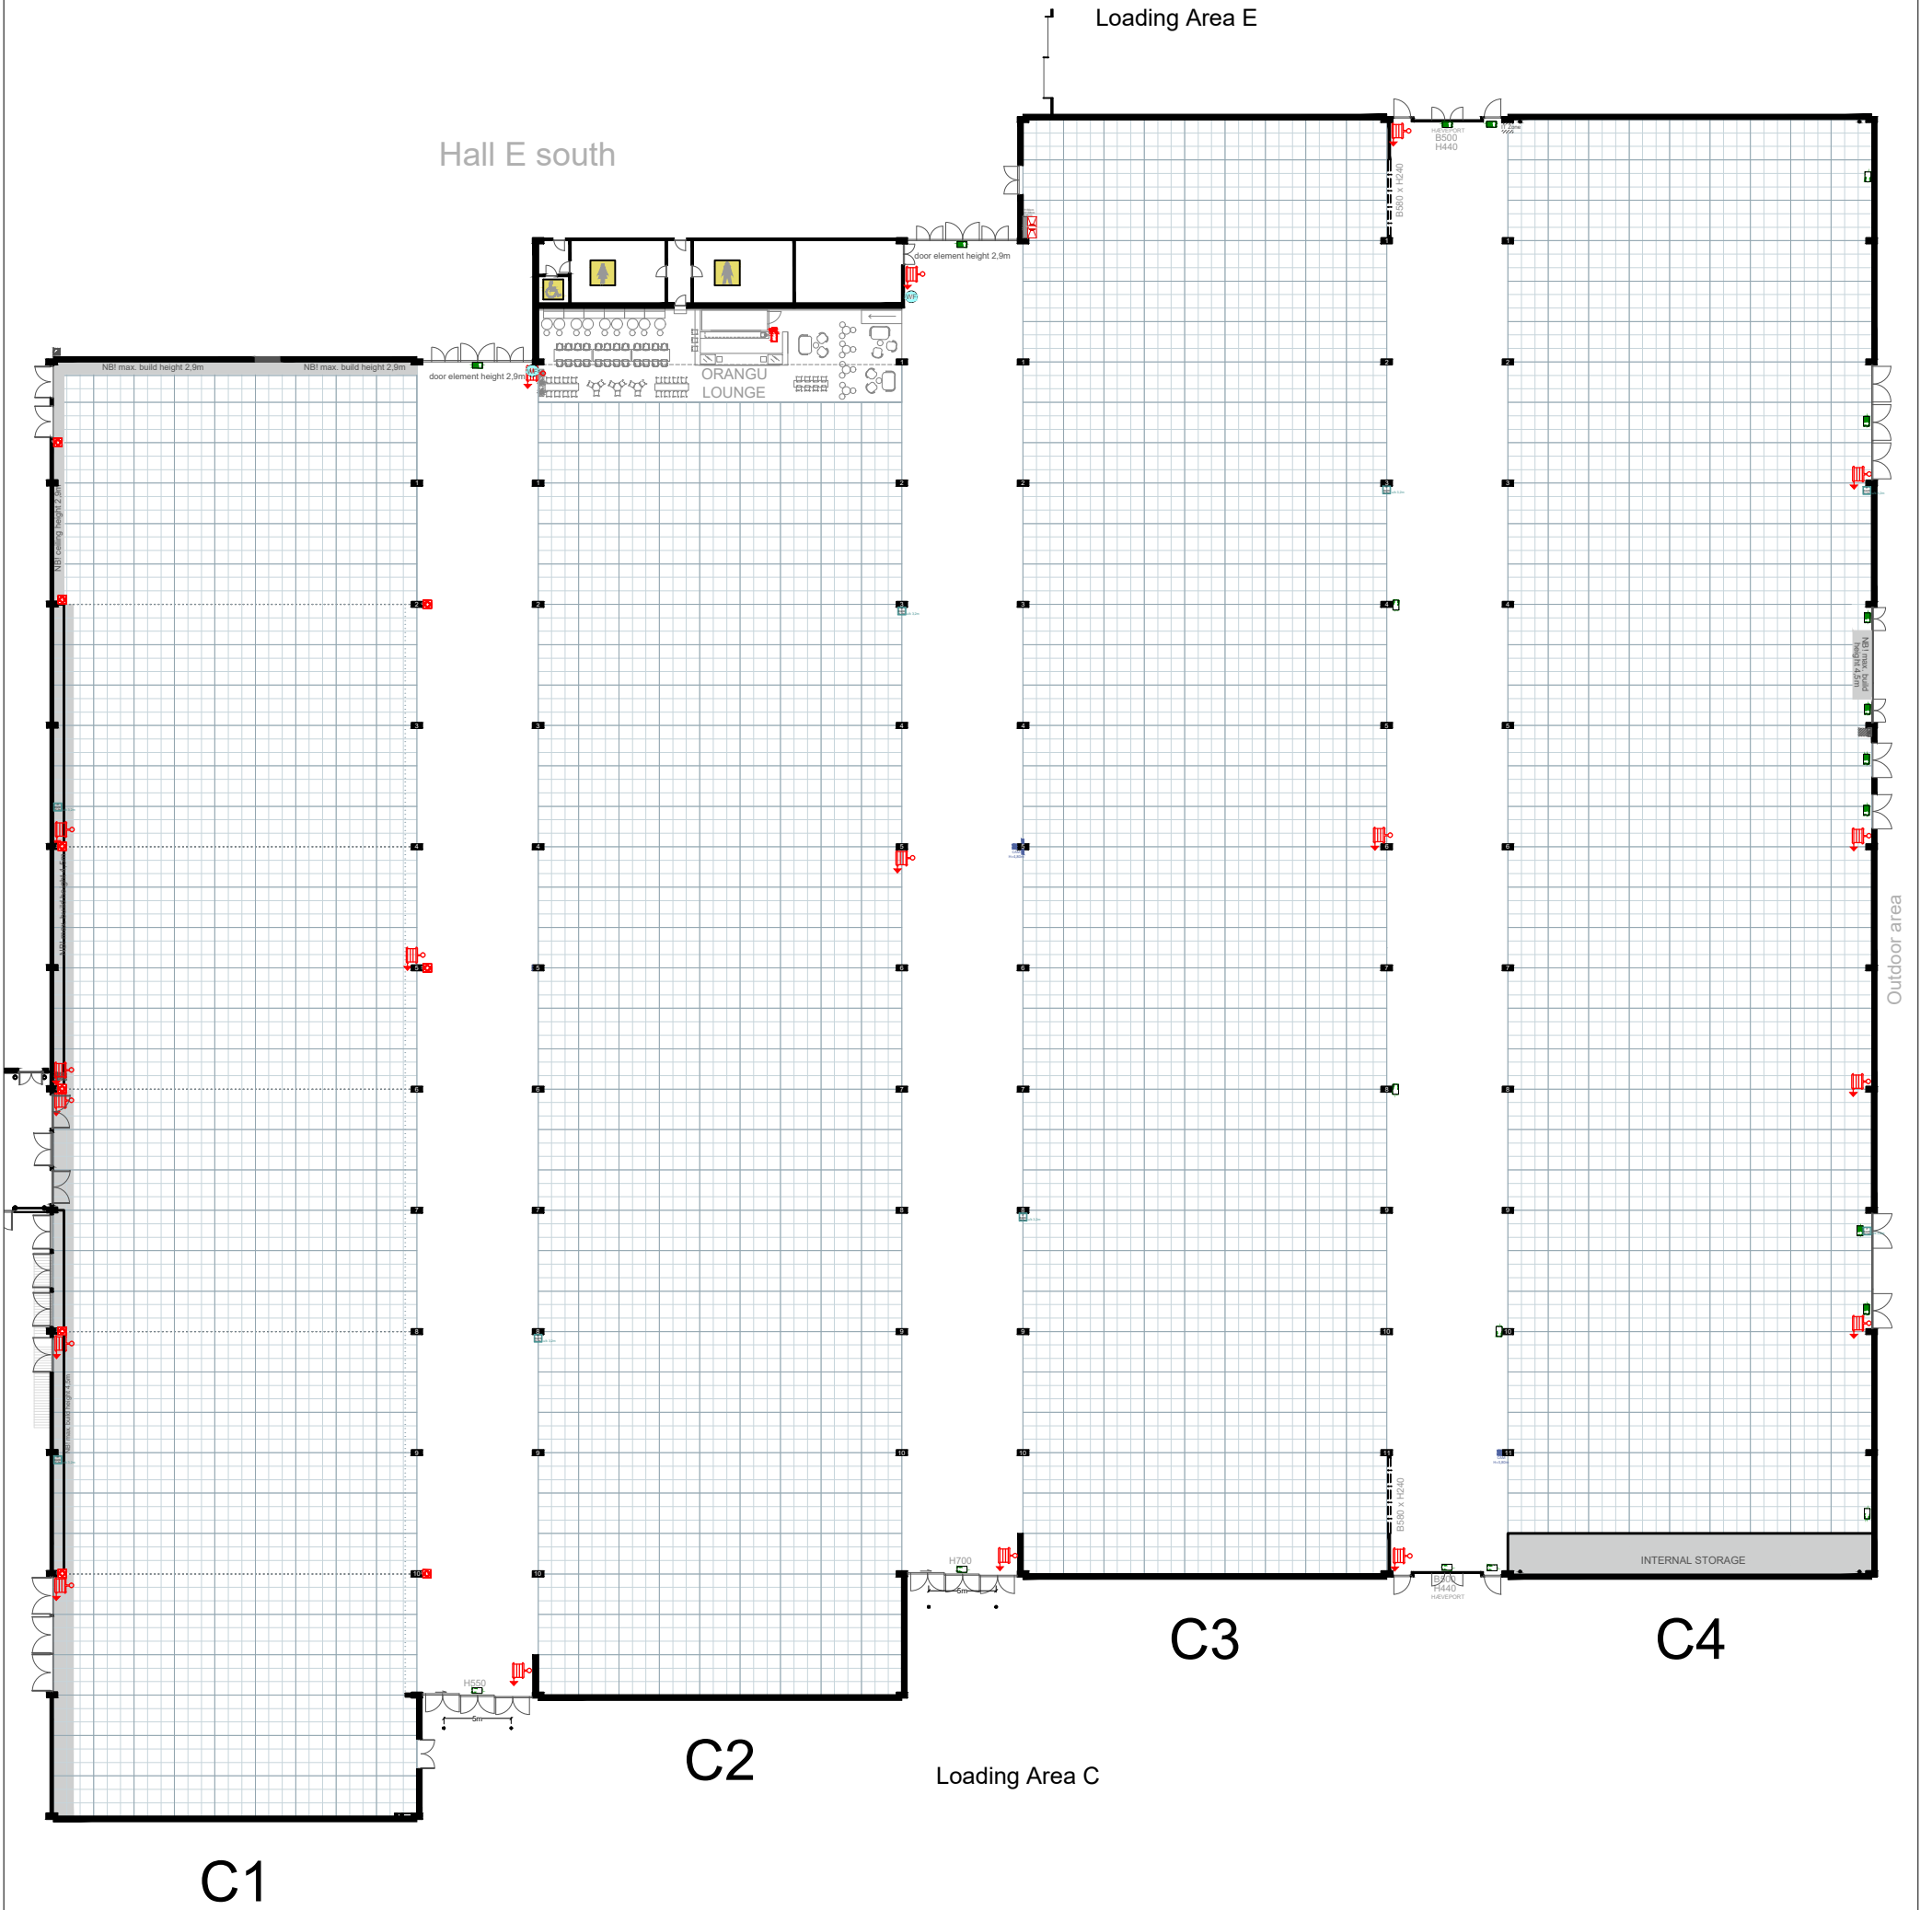
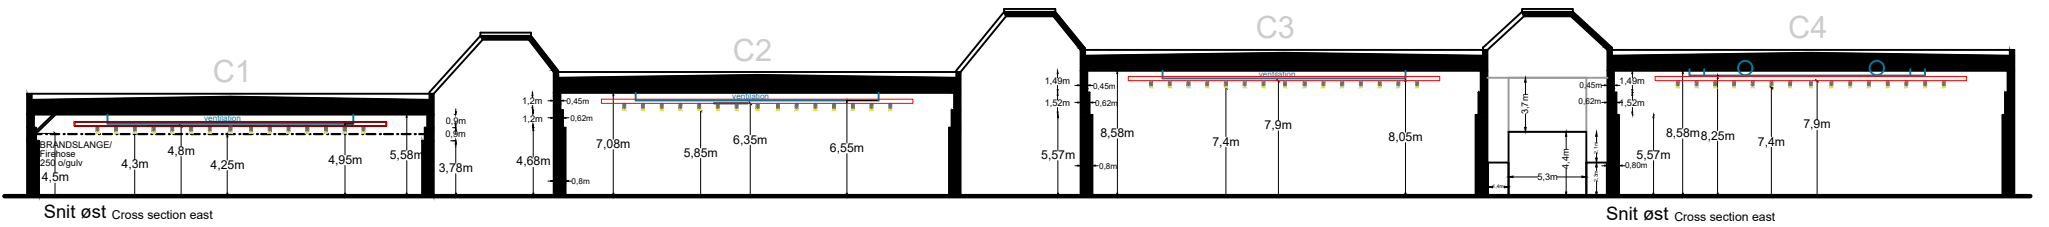


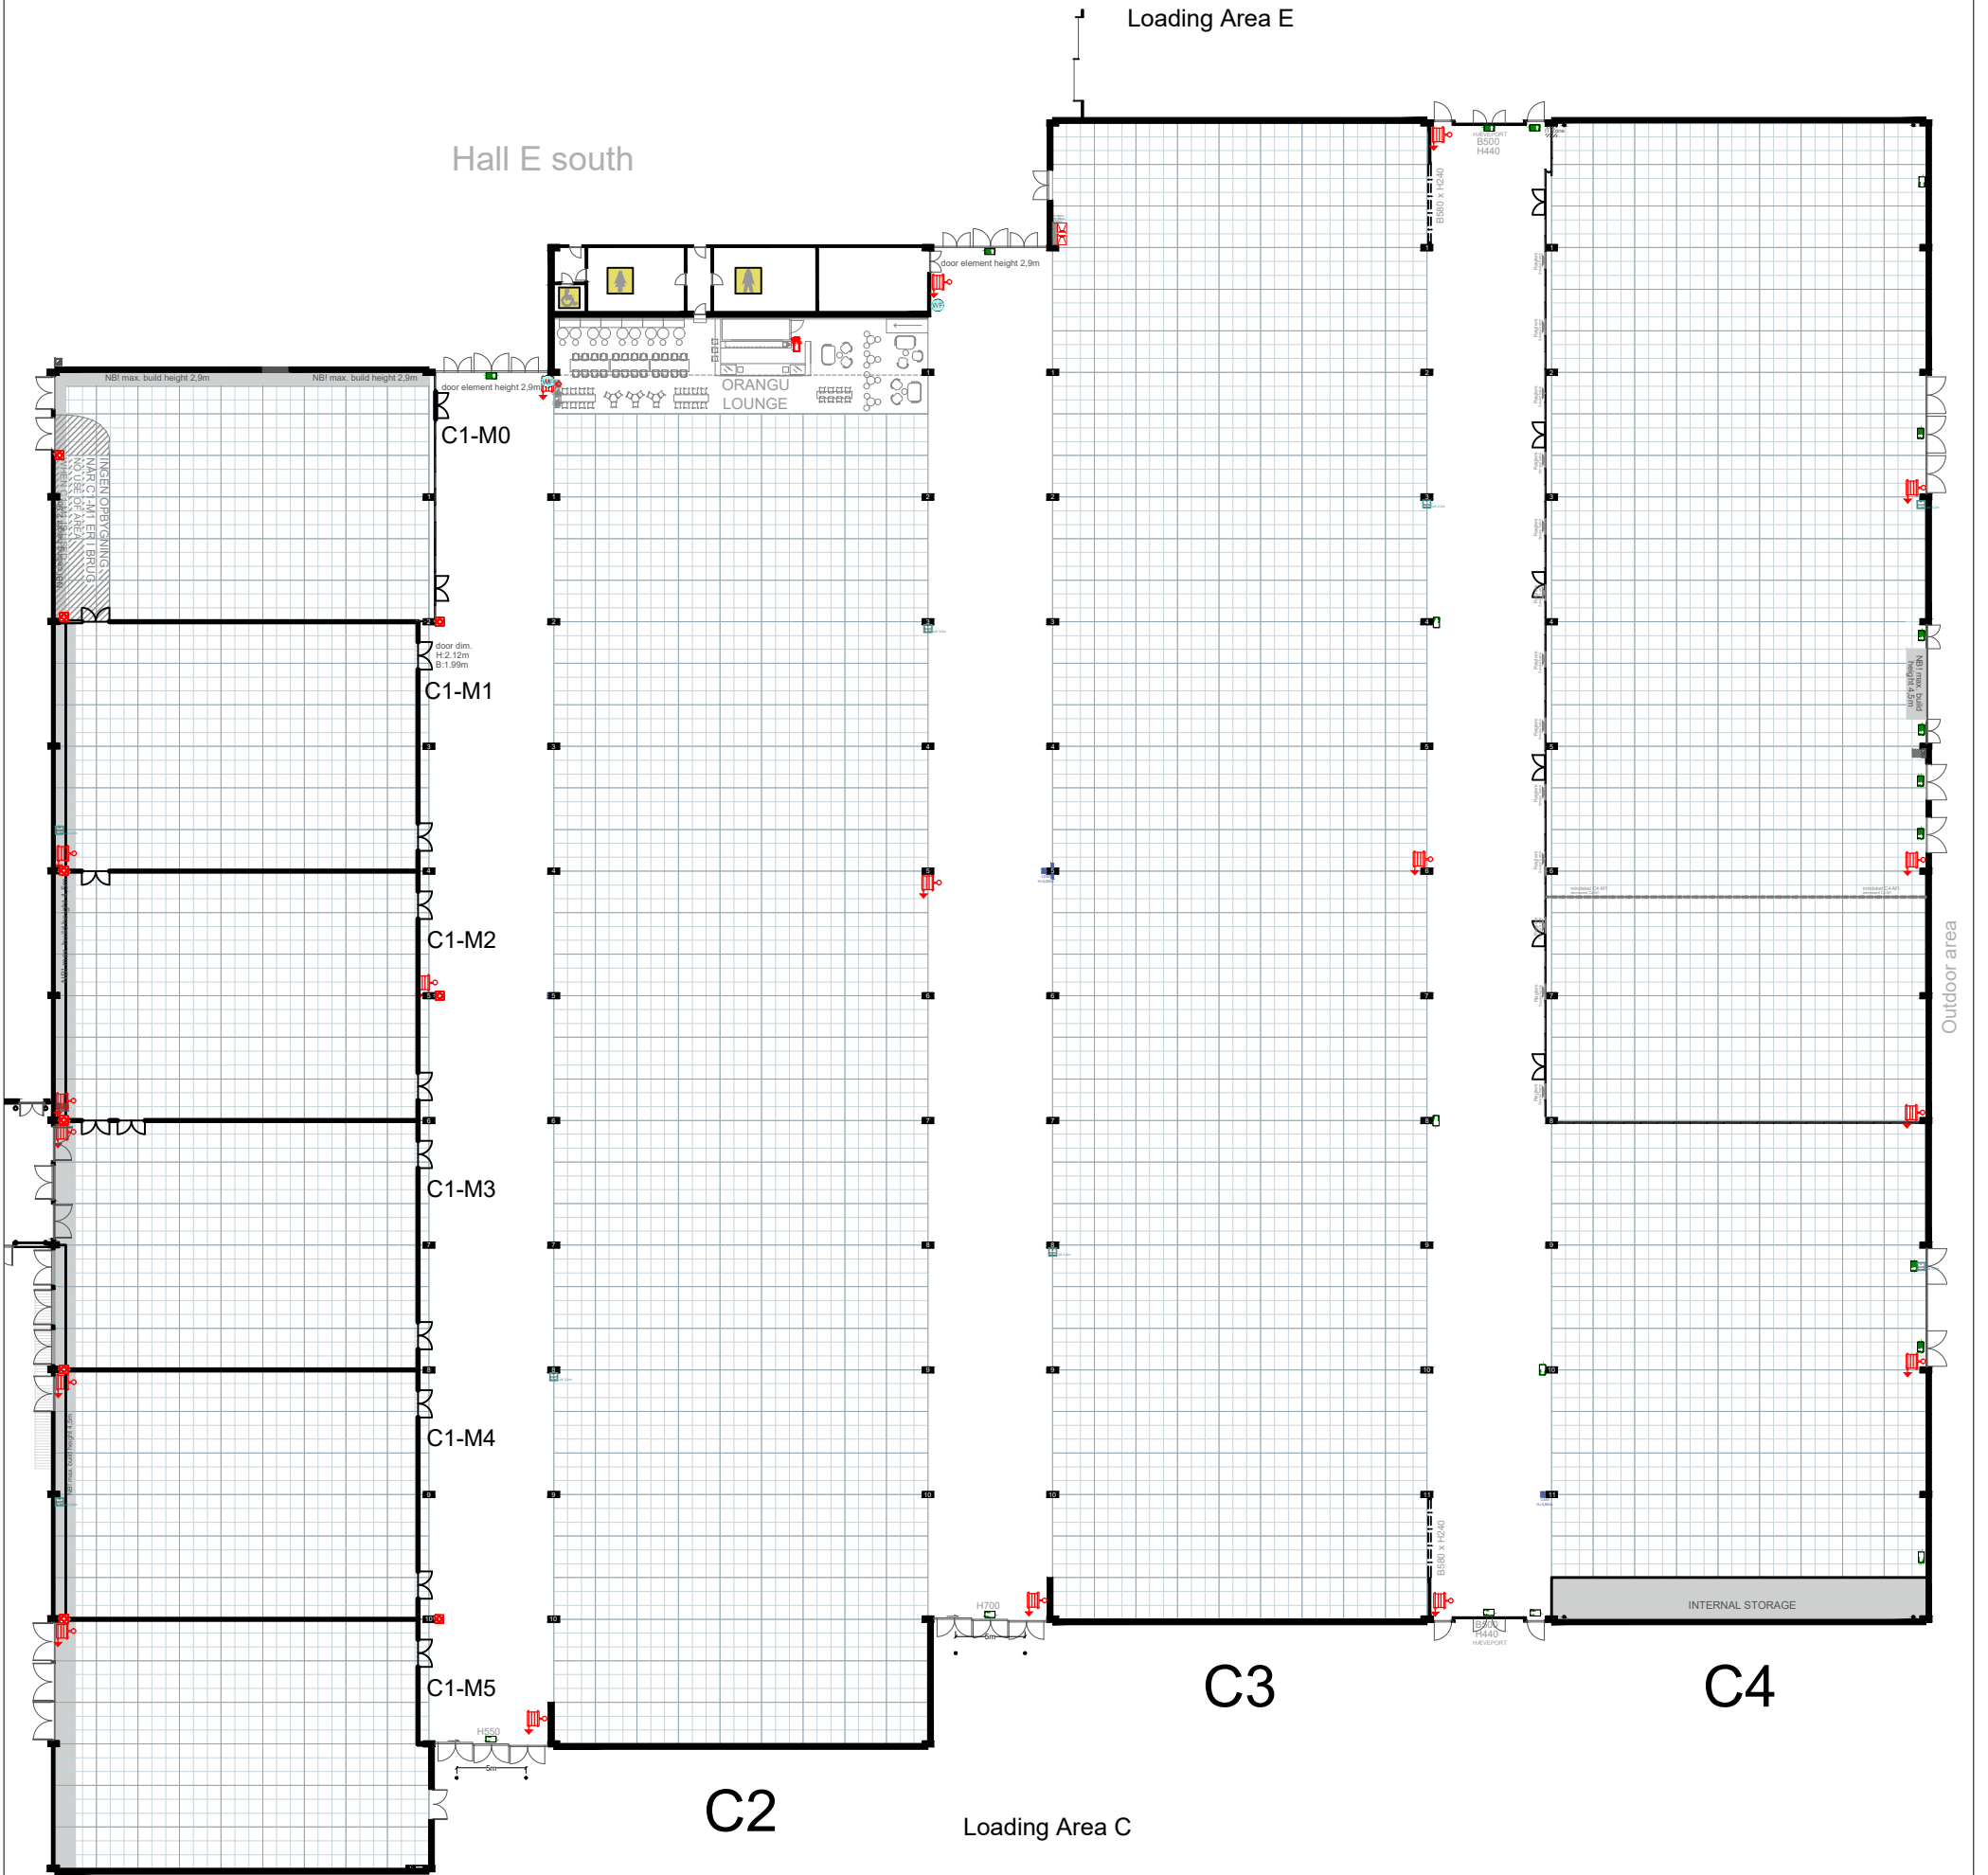

EVENT: Arrangement			ROOM or HALL: C-HALL	NAME: SALESPLAN
EVENT DATE: Dato Og År	LAST SAVE ABKJ	SCALE: FIT TO A3	REVISION DATE: 22. november 2024 15:46:16	
REVISION TEXT:			BC SET UP BC SET UP PREF. IN USE BY CUSTOMER BC DISMANTLING	NO:
FILENAME: C DEFAULT				

Alle rettigheder forbeholdes Bellagroup - yderligere brug af dokumenterne kun med godkendelse af Bellagroup - Alle målinger og oplysninger skal kontrolleres af kunden
All rights reserved Bellagroup - further use of the documents only with approval of Bellagroup - All measurements and information must be checked by the customer

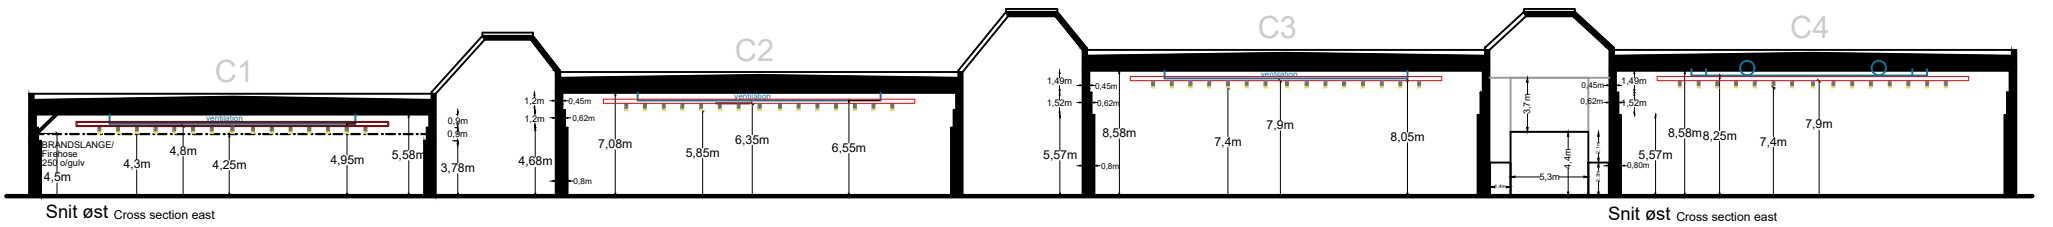

C1

OBS! gældende for alle C-hals mødelokaler

Tabel 2.2. Indretning af flugtvej og udgange i hallerne til fire end 150 personer					
Aantal personer pr. rum (flugtvej inkl.)	Den enkelte dørs mindste fri bredde (m)	Udrenes samlede mindste fri bredde (m)	Aantal uafhængige udgange til flugtvej ¹⁾	Aantal uafhængige flugtveje	
Mellem 151 og 350	1,20 ²⁾	1,93-3,50*	3	2	
Mellem 351 og 550	1,20 ²⁾	3,51-5,50*	4	3	
Mellem 551 og 750	1,20 ²⁾	5,51-7,50*	5	3	
Mellem 751 og 950	1,20 ²⁾	7,51-9,50*	6	3	
Mellem 951 og 1150	1,20 ²⁾	9,50-11,50*	7	4	

¹⁾ Se afsnit 2.3.4.3 vedrørende fri bredde. De 3,50 over gælder for de primære døre til flugtvej.

²⁾ Ved uafhængige udgange forstærkede udgange, der er placeret mindst 5 m fra hinanden.

EVENT: Arrangement			ROOM or HALL: C-HALL	NAME: SALESPLAN
EVENT DATE: Dato Og År			REVISION DATE: 22. november 2024 15:47:35	
REVISION TEXT:			BC SET UP BC SET UP PREF. IN USE BY CUSTOMER BC DISMANTLING	Bella Center COPENHAGEN
BLUE MARKINGS - DELIVERED BY EXTERN				
FILENAME: C DEFAULT				

Alle rettigheder forbeholdes Bellagroup - yderligere brug af dokumenterne kun med godkendelse af Bellagroup - Alle målinger og oplysninger skal kontrolleres af kunden
All rights reserved Bellagroup - further use of the documents only with approval of Bellagroup - All measurements and information must be checked by the customer